

Primme® Manual | K-76317

Urinal flushometer, 0.125 gpf

Features

- Fixture-mount design
- Chloramine resistance on all rubber components exposed to waterway
- Includes vacuum breaker and control stop



Sustainability



Available Colors/Finishes

Color tiles intended for reference only.

■ CP Polished Chrome



Codes/Standards

ADA, OBC, CSA B651 compliant when installed to the specific requirements of these regulations.

This product should be used with a WaterSense labeled counterpart with the same rated flush volume to ensure the complete system meets the requirements of this specification for water efficiency and performance.



ADA CSA B651 OBC

ASSE 1037/ASME A112.1037/CSA B125.37

EPA WaterSense®

ADA

ICC/ANSI A117.1

CSA B651

OBC

Warranty

See website for detailed warranty information.

KOHLER® One-Year Limited Warranty

Technical Information

All product dimensions are nominal.

Handle

Handle Style/ Type: Lever

Pressure/Fixture Supply Requirements

Minimum Flowing Pressure: 25 psi (172.4 kPa)

Minimum Flow Rate: 3.5 gpm (13.2 l/min)

Material

- Durable brass construction

Recommended Products/Accessories

K-23723 Faucet cleaner

Technology

- Nonhold open piston technology for accurate activation




1-800-4KOHLER (1-800-456-4537)

Kohler Co. reserves the right to make revisions without notice to product specifications.

For the most current specification sheet, go to www.kohler.com USA or www.kohler.ca Canada.

4-15-2026 3:15 - US-CA

*10-3/4" (273 mm) minimum with a 6" (152 mm) critical level above the fixture

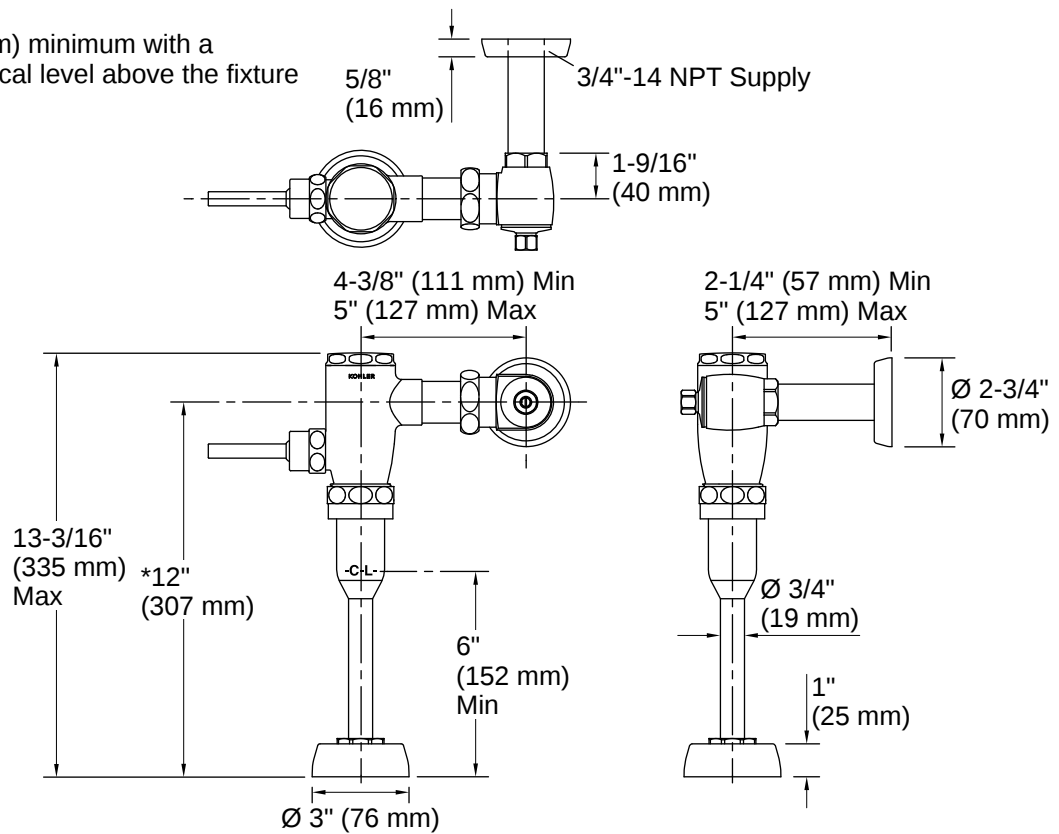

Installation

- Intended for urinal installations with 3/4" (19 mm) top spud coupling connection

Installation Notes

Install this product according to the installation instructions.

This product should be used with a WaterSense labeled counterpart with the same rated flush volume to ensure the complete system meets the requirements of this specification for water efficiency and performance.

ADA, OBC, CSA B651 compliant when installed to the specific requirements of these regulations.

